



TEST REPORT

IEC/EN 60898-1

Circuit-breakers for over current protection for household and similar installations

Report Reference No.....: 03601-A-18D0007-S

Date of issue: 2018-05-02

Total number of pages: 106

CB/CCA Testing Laboratory: Suzhou Electrical Apparatus Science Research Institute Co., Ltd.
(EETI)

Address: No.7 Yonghe Street, Binhe Road, New District, Suzhou, China

Applicant's name: Zhejiang Tengen Smart Electrics Co., Ltd.

Address: No.2777 West Zhongshan Road, Xiuzhou District, Jiaxing, Zhejiang
Province, P.R.China**Test specification:**Standard: ☐ IEC 60 898-1:2002 (1st Edition) + A1:2002 + A2:2003 and/or
☒ EN 60 898-1:2003 + A1:2004 + A11:2006

Test procedure: CCA

Non-standard test method.....: N/A

Test Report Form No.....: IECEN 60898_1C

Test Report Form(s) Originator.....: OVE

Master TRF: Dated 2007-12

Copyright © 2007 IEC System for Conformity Testing and Certification of Electrical Equipment (IECEE), Geneva, Switzerland. All rights reserved.

This publication may be reproduced in whole or in part for non-commercial purposes as long as the IECEE is acknowledged as copyright owner and source of the material. IECEE takes no responsibility for and will not assume liability for damages resulting from the reader's interpretation of the reproduced material due to its placement and context.

If this Test Report Form is used by non-IECEE members, the IECEE/IEC logo and the reference to the CB Scheme procedure shall be removed.

This report is not valid as a CB Test Report unless signed by an approved CB Testing Laboratory and appended to a CB Test Certificate issued by an NCB in accordance with IECEE 02.

If this Test Report Form is used by non-CCA members, the CIG logo and the reference to the CCA Procedure shall be removed.

This report is not valid as a CCA Test Report unless signed by an approved CCA Testing Laboratory and appended to a CCA Test Certificate issued by an NCB in accordance with CCA

Test item description: Miniature circuit-breaker

Trade Mark: Tache

Manufacturer: Zhejiang Tengen Smart Electrics Co., Ltd.

Model/Type reference: TeB5-40

Ratings: Ui:500V, Uimp:4kV; Ue:AC230V;


In:6A, 10A, 16A, 20A, 25A, 32A, 40A;

Type of instantaneous tripping current: B, C, D;

Ics=Icn:6kA;

Poles: 1P+N(1protected pole with a switched neutral pole).

Testing procedure and testing location:	
<input checked="" type="checkbox"/> CB/CCA Testing Laboratory:	Suzhou Electrical Apparatus Science Research Institute Co., Ltd.(EETI)
Testing location/ address.....:	No.7 Yonghe Street, Binhe Road, New District, Suzhou, China
<input type="checkbox"/> Associated CB Laboratory:	N/A
Testing location/ address.....:	N/A
Tested by (name + signature).....:	Lu Jianping
Approved by (name + signature) ..:	Zhang Jie
<input type="checkbox"/> Testing procedure: TMP	N/A
Tested by (name + signature).....:	N/A
Approved by (+ signature)	N/A
Testing location/ address.....:	N/A
<input type="checkbox"/> Testing procedure: WMT	N/A
Tested by (name + signature).....:	N/A
Witnessed by (+ signature).....:	N/A
Approved by (+ signature)	N/A
Testing location/ address.....:	N/A
<input type="checkbox"/> Testing procedure: SMT	N/A
Tested by (name + signature).....:	N/A
Approved by (+ signature)	N/A
Supervised by (+ signature).....:	N/A
Testing location/ address.....:	N/A
<input type="checkbox"/> Testing procedure: RMT	N/A
Tested by (name + signature).....:	N/A
Approved by (+ signature)	N/A
Supervised by (+ signature).....:	N/A
Testing location/ address.....:	N/A

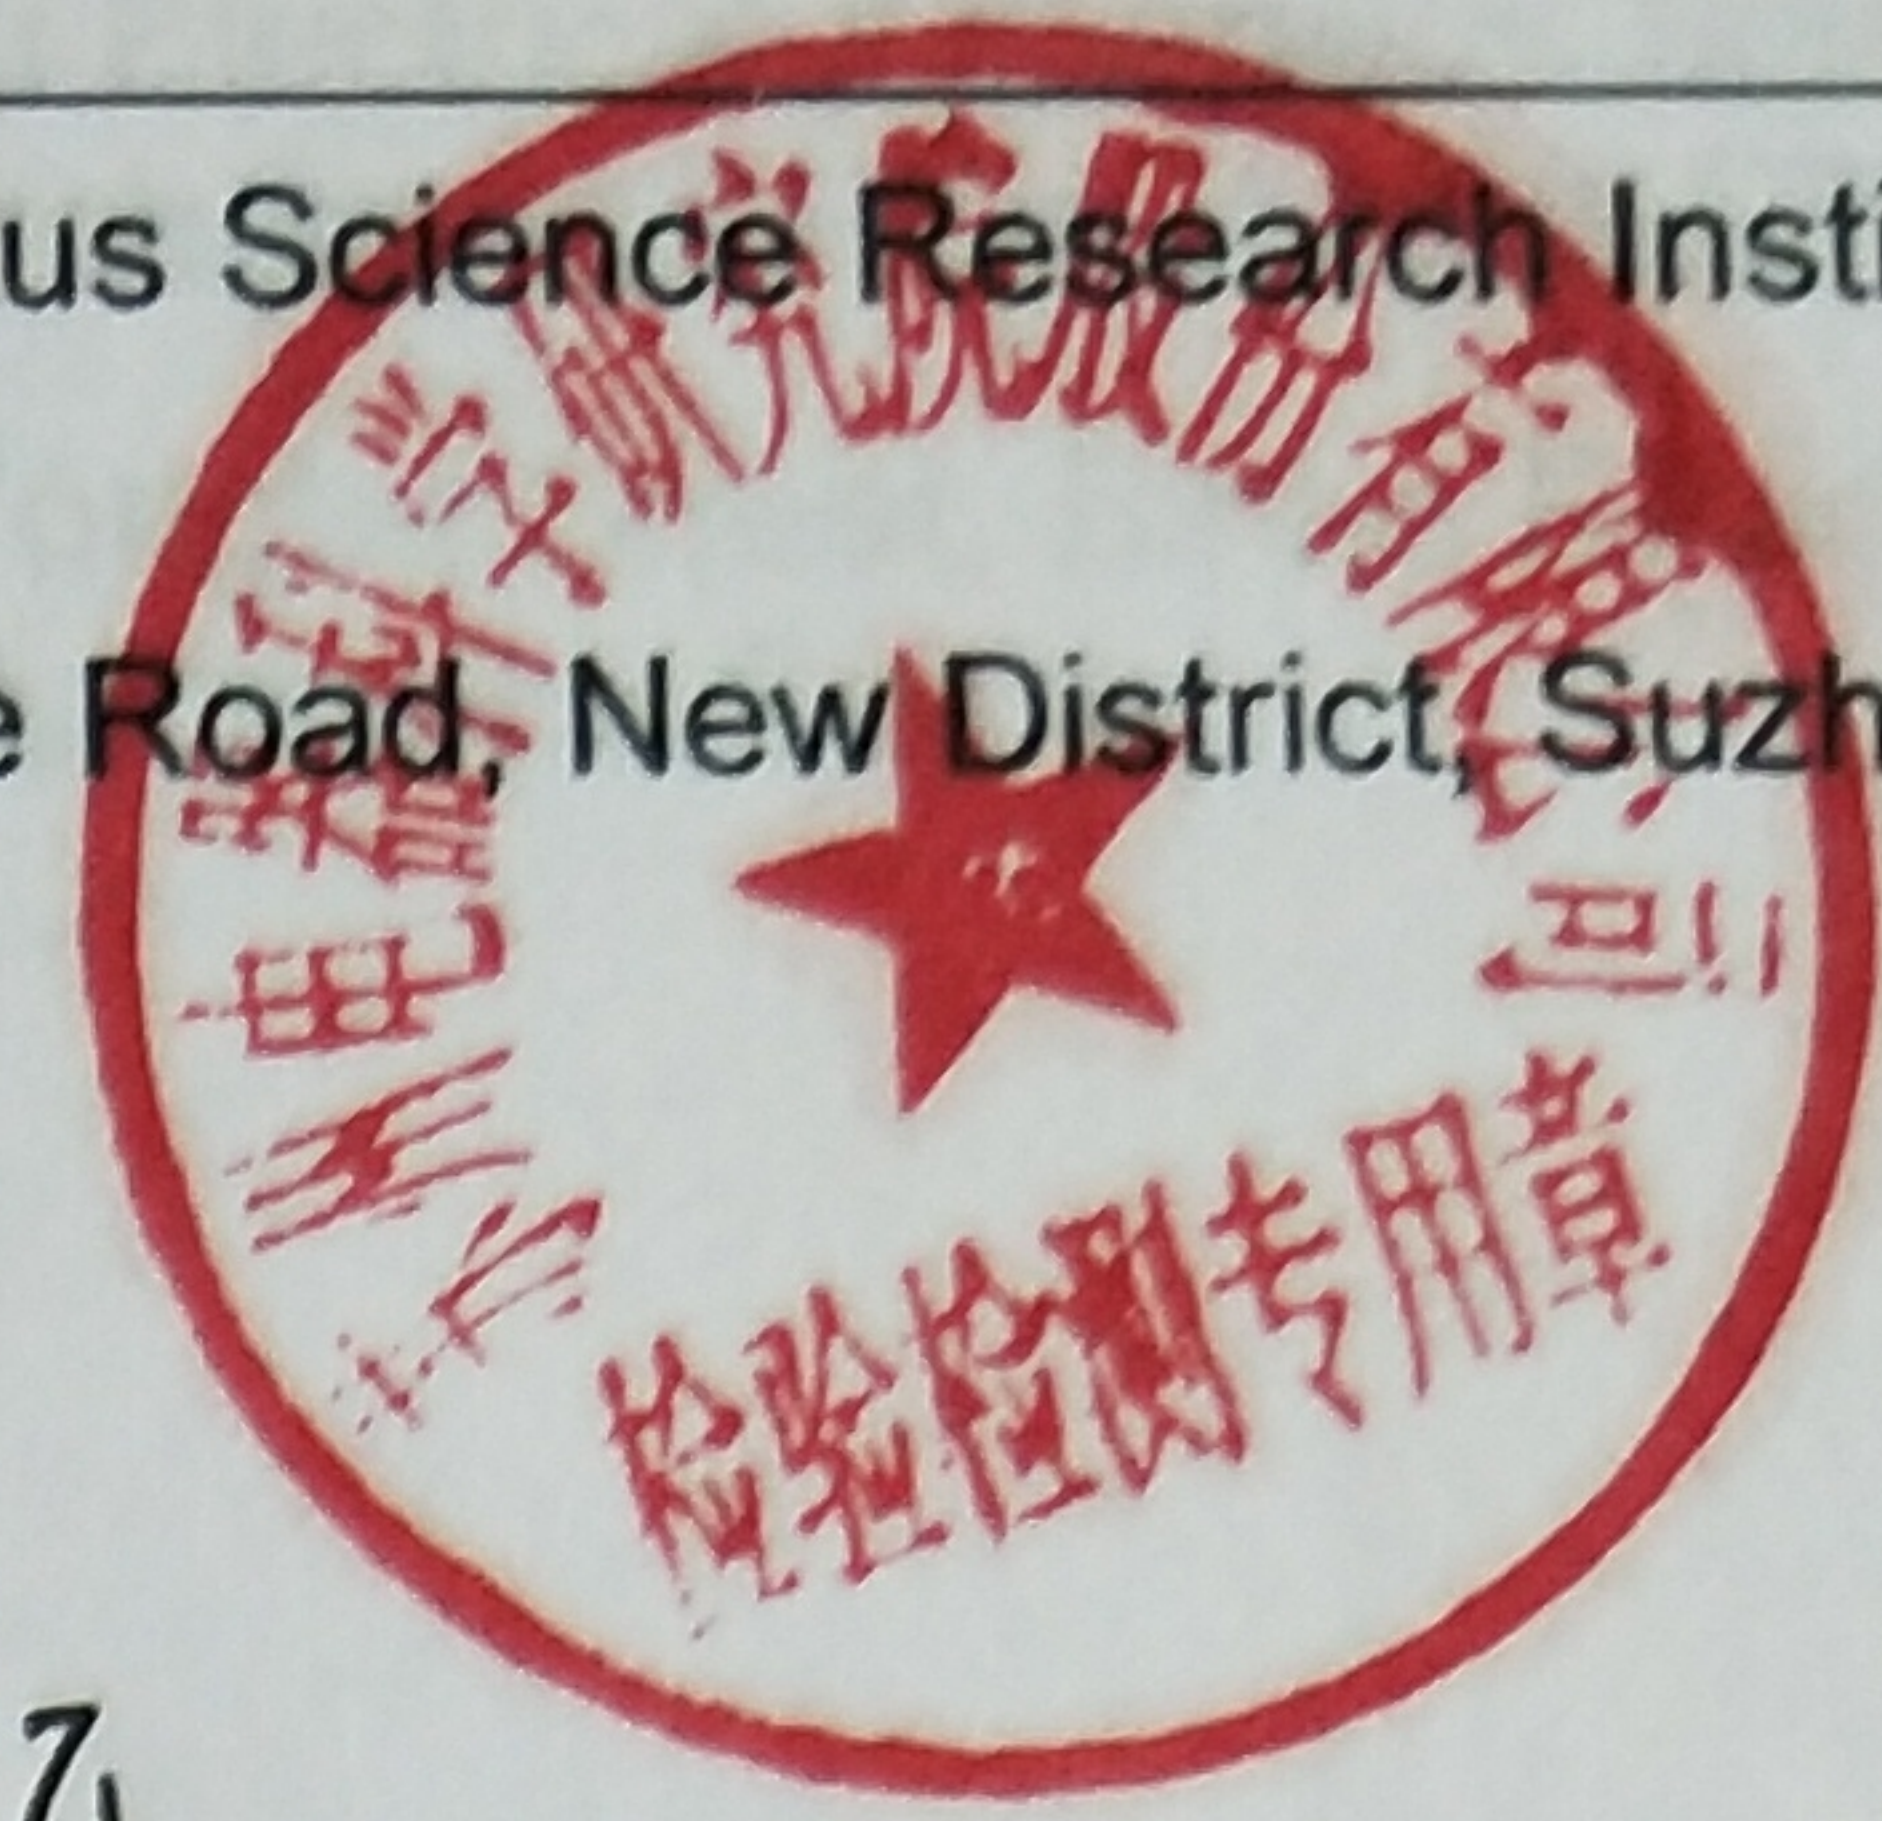

鲁建平
张洁